


# SANITARY SEWER PIPE BEDDING

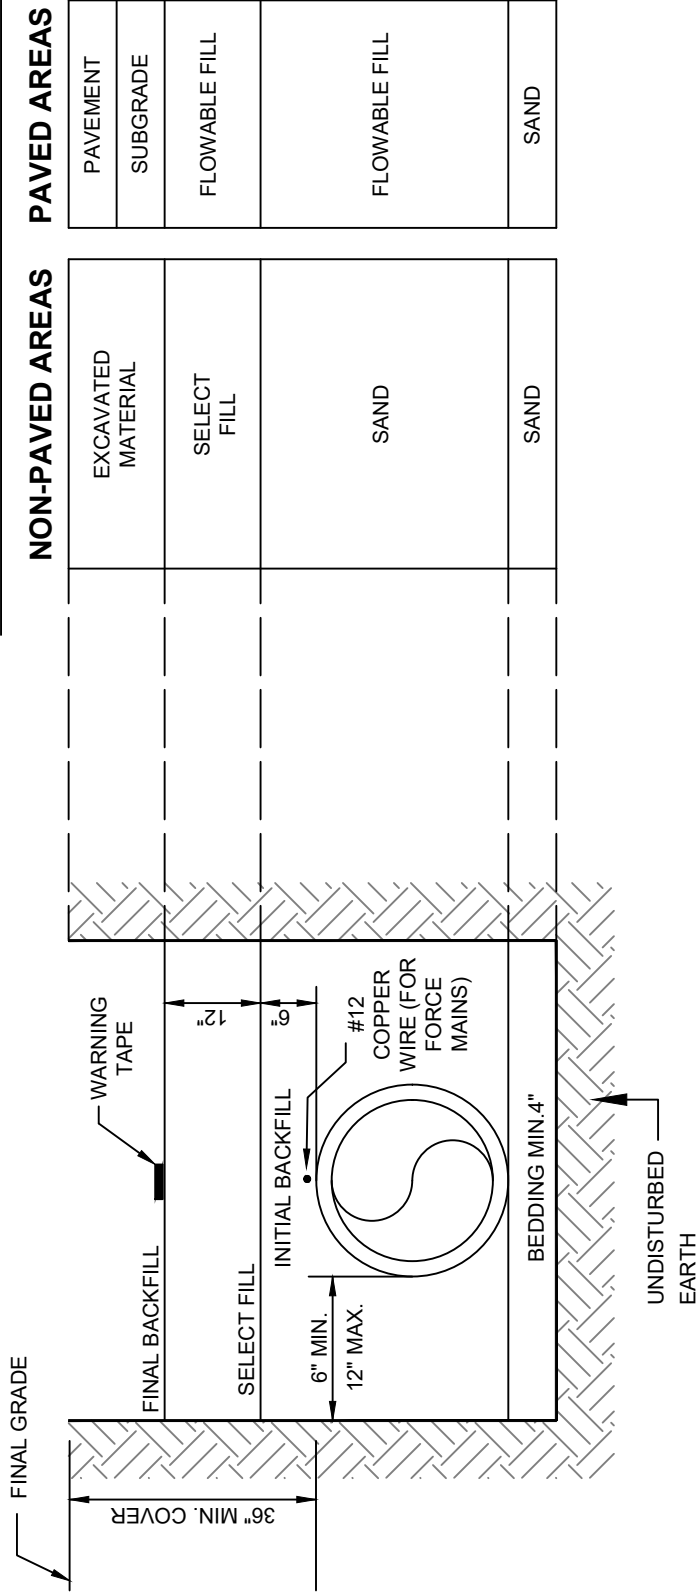

NON-PAVED AREAS		PAVED AREAS	
	EXCAVATED MATERIAL	PAVEMENT	
	SELECT FILL	SUBGRADE	
	SAND	FLOWABLE FILL	
	SAND	FLOWABLE FILL	
		SAND	

- NOTES:
1. SELECT FILL CONSISTS OF EXCAVATED MATERIALS CONTAINING NO ROCKS LARGER THAN 2".
  2. NON-PAVED AREAS SHALL BE COMPACTED TO 90% MAX. STANDARD PROCTOR DENSITY FOR COHESIONLESS SOILS AND 85% FOR COHESIVE SOILS.
  3. FILLS OVER 12' DEEP SHALL BE WELL GRADED 3/4" CRUSHER RUN FROM BEDDING TO TOP OF SELECT FILL.
  4. FLOWABLE FILL SHALL BE USED IN PAVED AREAS FROM BEDDING TO BOTTOM OF PAVEMENT.
  5. SEE SAN-01 FOR SEWER PIPE MATERIAL REQUIREMENTS.

REVISION	BY	DATE

<b>SANITARY SEWER PIPE BEDDING</b>		
STANDARD DETAILS		
CITY OF JENKS, OKLAHOMA		
ENGINEERING DEPARTMENT		
DATE:	4-11-22	STANDARD NO. SAN-02