



PROVIDE APPROPRIATE
TRANSITION BETWEEN
STABILIZED CONSTRUCTION
ENTRANCE AND PUBLIC
RIGHT-OF-WAY AS NEEDED.

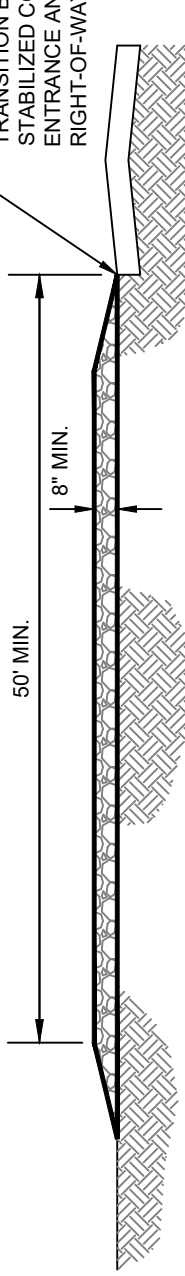

PROFILE VIEW

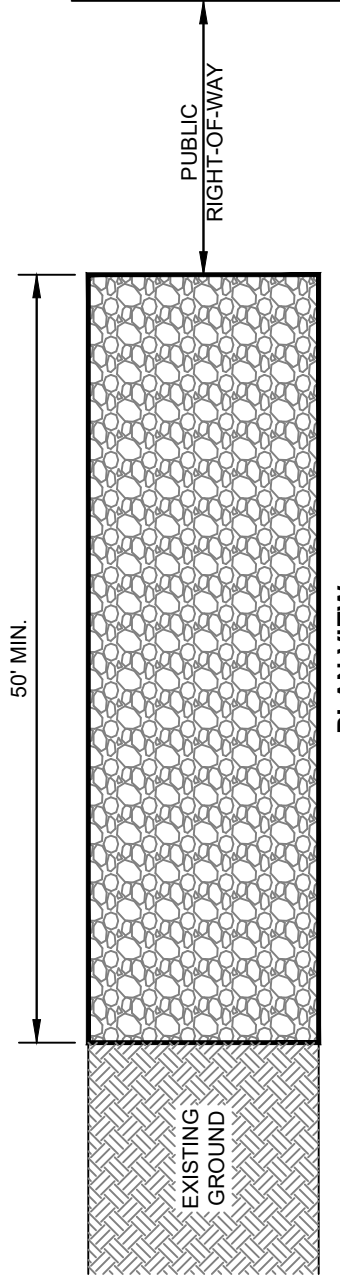

PLAN VIEW

NOTES:

1. CRUSHED STONE SIZE AASHTO DESIGNATION M43, SIZE NO. 2 (1 1/2" TO 2 1/2").
2. LENGTH - AS EFFECTIVE, BUT NOT LESS THAN 50'.
3. THICKNESS - NO LESS THAN 8".
4. WIDTH - NOT LESS THAN FULL WIDTH OF ALL POINTS OF DESIGNATED CONSTRUCTION ENTRANCE/S.
5. WASHING - WHEN NECESSARY, WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH, OR WATERCOURSE THROUGH USE OF SAND BAGS OR GATOR GUARD (SEE STRM-18).
6. MAINTENANCE - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO CONTROL SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHT-OF-WAY MUST BE REMOVED IMMEDIATELY BY THE OWNER.

REVISION	BY	DATE

STABILIZED CONSTRUCTION ENTRANCE	
STANDARD DETAILS	
CITY OF JENKS, OKLAHOMA	
ENGINEERING DEPARTMENT	
DATE: 4-11-22	STANDARD NO. STRM-20